



Modbus

Pioneer reglering

Pioneer, Mini Retro P, Mini Pi, Micro Pd

Innehåll

1	Allmänt.....	2
1.1	Information om dokumentet	2
1.2	Anslutningsplint i centralen	2
1.3	Anslutning av kommunikationsmodul CMO.....	2
1.4	Inkoppling av Modbus.....	3
1.5	Upphängning av CMO på vägg.....	4
1.6	Aktivera Modbus.....	4
1.7	Välj Wifi och/eller Modbus	4
1.8	Modbus.....	4
1.9	Anslut en Modbus givare.....	4
2	Parameterlista	5

Denna manual är publicerad av Cetetherm.

Cetetherm kan vid behov och utan att meddela, göra ändringar och förbättringar av innehållet i manualen på grund av felaktig information eller ändringar av hårdvara eller mjukvara.

Alla eventuella ändringar kommer ingå i framtida utgåva av manualen.

1.1 Information om dokumentet

1.2 Anslutningsplint i centralen

[illegible]



-
- Diagram showing the back of the device with labels AA32, PF1, AA23-X1, and S3.

AA32	Plats för MicroSD-kort
PF1	LED indikering
S3	Reset knapp
AA23-X1	Kopplingsplint, strömmatning

2

Kontaktdonet AA23-X1 i CMOkän lyftas bort för att förenkla monteringen. Kom ihåg att återmontera kontaktdonet innan styrmodulen åter spänningssätts.


Anslut CMO till centralen på anslutningsplinten AA102-X1, märkt CMO (12-15).

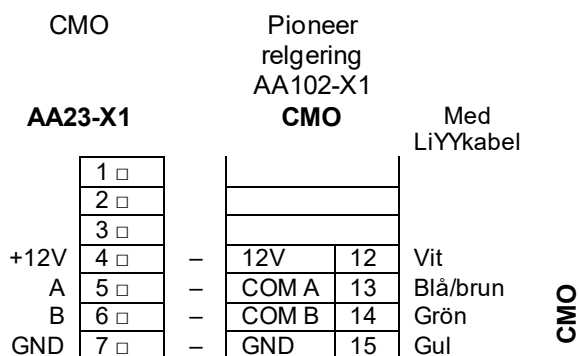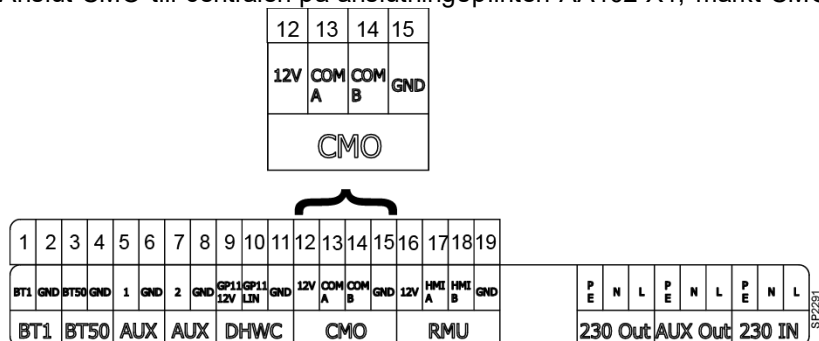

1.4 Inkoppling av Modbus

Anslut Modbus kabeln till CMO på kopplingsplinten AA23X1, märkt 1 och 2. Anslut med exempelvis LiYY, EKKX eller liknande, max kabellängd 50m, vid ledningsarea 0.5 mm².

Kontaktdonet AA23-X1 i CMOkän lyftas bort för att förenkla monteringen. Kom ihåg att återmontera kontaktdonet innan styrmodulen åter spänningssätts.

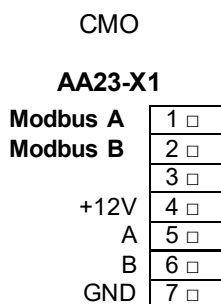


Modbus

Pioneer reglering

1.5 Upphängning av CMO på vägg

Använd alla fästpunkter och montera CMO40 upprätt plant mot vägg, skruvstorlek M2,5 med skruvskalle på max 5,5mm. Lämna minst 100 mm fritt utrymme runtom för att underlätta åtkomst samt kabeldragning vid installation och service.

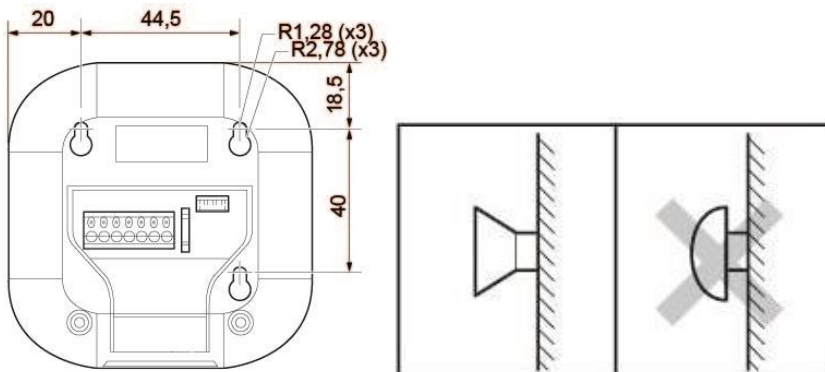

1.6 Aktivera Modbus

För att använda Modbus måste följande inställning göras i rumsenheten RMU.

- Meny 4.1 – Driftläge.
Välj driftläge Utomhusstyrning med rumsgivare. – kräver en ansluten utomhus- och inomhusgivare, kan vara via Modbus. Fungerar som utomhusstyrning med tillägget att inställd önskad rumstemperatur, meny 1.1.1 Värme, används för att beräkna offset på framledningstemperatur

1.7 Välj Wifi och/eller Modbus

I meny 7.2.16 – CMO40, välj om Modbus eller både Modbus och Wifi ska vara aktiva.

Fail safe mode **On**: Wifi och Modbus

Fail safe mode **Off**: Endast Modbus

1.8 Modbus

Anslutning mot Modbus använder alltid default adress 247.

Denna adress kan ändras i meny 5.8 – TPP Configure.

Skrivbart värde mellan 1-245 och 247. Adress 246 är upptagen.

BaudRate:	57600
DataBits:	x8
StopBits:	One
Parity:	Even

1.9 Anslut en Modbus givare

Om en Modbus givare ansluts måste den aktiveras i meny 7.2.16 – CMO40, aktivera Room temp.Modbus.

2 Parameterlista

ID	Name	TPP Holding Reg	TPP Input Reg	Regs Count	Unit	Is signed	Variable size	Prescaler	Points after dot
3663	System mode, climate system 1	-	--	1	eUnitNone	Unsigned	8	1	0
60371	BT50 Modbus sensor	0	-	1	eUnitCelsius	Signed	16	10	1
60373	Modbus desired temperature	1	-	1	eUnitCelsius	Signed	16	10	1
60375	Modbus heating curve	2	-	1	eUnitNone	Unsigned	8	1	0
60376	Modbus heating min supply	3	-	1	eUnitCelsius	Signed	16	10	1
60377	Modbus heating max supply	4	-	1	eUnitCelsius	Signed	16	10	1
60378	Modbus limit max power	5	-	1	eUnitNone	Unsigned	8	1	0
60379	Modbus max output	6	-	1	eUserUnitKiloWatt	Signed	16	10	0
60386	Modbus Kc, heating	7	-	1	eUnitNone	Unsigned	8	100	2
60388	Modbus Ti, heating	8	-	1	eUnitSecond	Unsigned	16	10	0
7014	Modbus Samples to run heating	9	-	1	eUnitSecond	Unsigned	16	1	0
4	BT1, current outdoor temperature	-	101	1	eUnitCelsius	Signed	16	10	1
54	BT1, average temperature	-	102	1	eUnitCelsius	Signed	16	10	1
60139	BT38, hot water out	-	103	1	eUnitCelsius	Signed	16	10	1
60140	BT4, cold water	-	104	1	eUnitCelsius	Signed	16	10	1
60137	BT69.1, primary return heating	-	105	1	eUnitCelsius	Signed	16	10	1
60142	BT68, primary in	-	106	1	eUnitCelsius	Signed	16	10	1
60138	BT69.2, primary out hot water	-	107	1	eUnitCelsius	Signed	16	10	1
60130	BT2, supply heating	-	108	1	eUnitCelsius	Signed	16	10	1
60131	BT3, return heating	-	109	1	eUnitCelsius	Signed	16	10	1
60238	Controlling room sensor, climate system 1	-	110	1	eUnitCelsius	Signed	16	10	1
60303	Indoor temperature, external	-	111	1	eUnitCelsius	Signed	16	10	1
60304	Indoor temperature	-	112	1	eUnitCelsius	Signed	16	10	1
60433	Relative humidity	-	113	1	eUnitPercent	Unsigned	16	10	1
781	Degree minutes	-	115	2	eUnitDegreeMinutes	Signed	32	10	0
60157	GP1, status	-	118	1	eUnitNone	Unsigned	8	1	0

ID	Name	TPP Holding Reg	TPP Input Reg	Regs Count	Unit	Is signed	Variable size	Prescaler	Points after dot
60159	GP1, pump speed	-	119	1	eUnitPercent	Unsigned	16	10	1
60106	GP1 Flow	-	120	1	eUnitLitresPerMinute	Signed	16	10	1
60105	GP1 Head	-	121	1	eUnitBar	Signed	16	100	2
60156	BF4, hot water flow	-	126	1	eUnitLitresPerMinute	Signed	16	100	2
60149	BP17, prim. in pressure	-	127	1	eUnitBar	Signed	16	1000	2
60150	BP18, prim. out pressure	-	128	1	eUnitBar	Signed	16	1000	2
60152	BP17-BP18, primary diff pressure	-	129	1	eUnitBar	Signed	16	1000	2
60151	BP19, heating pressure	-	130	1	eUnitBar	Signed	16	1000	2
60144	Operating pressure	-	131	1	eUnitBar	Signed	16	100	2
3665	Desired room temperature (no room sensor) climate system 1, heating	-	132	1	eUnitCelsius	Signed	16	10	1
3945	Set point value, room temp system 1	-	134	1	eUnitCelsius	Signed	16	10	1
60330	QN11.2, valve position	-	136	1	eUnitPercent	Unsigned	16	10	1
60329	QN11.1, valve position	-	137	1	eUnitPercent	Unsigned	16	10	1
60216	HW, set value	-	138	1	eUnitCelsius	Signed	16	10	0
60205	Priority hot water	-	139	1	eUnitNone	Unsigned	8	1	0
3375	Alarm number	-	140	1	eUnitNone	Unsigned	16	1	0
60493	Energy consumption hot water [most recent 24-hour period per hour]	-	141	2	eUserUnitKiloWattHour	Unsigned	32	100	0
60494	Energy consumption heating [most recent 24-hour period per hour]	-	143	2	eUserUnitKiloWattHour	Unsigned	32	100	0
60496	Energy consumption hot water [previous day]	-	145	2	eUserUnitKiloWattHour	Unsigned	32	100	0
60497	Energy consumption heating [previous day]	-	147	2	eUserUnitKiloWattHour	Unsigned	32	100	0
60498	Energy consumption [previous day]	-	149	2	eUserUnitKiloWattHour	Unsigned	32	100	0
60499	Ratio heating [previous day]	-	151	1	eUnitPercent	Signed	16	10	0
60500	Ratio hot water [previous day]	-	152	1	eUnitPercent	Signed	16	10	0

